



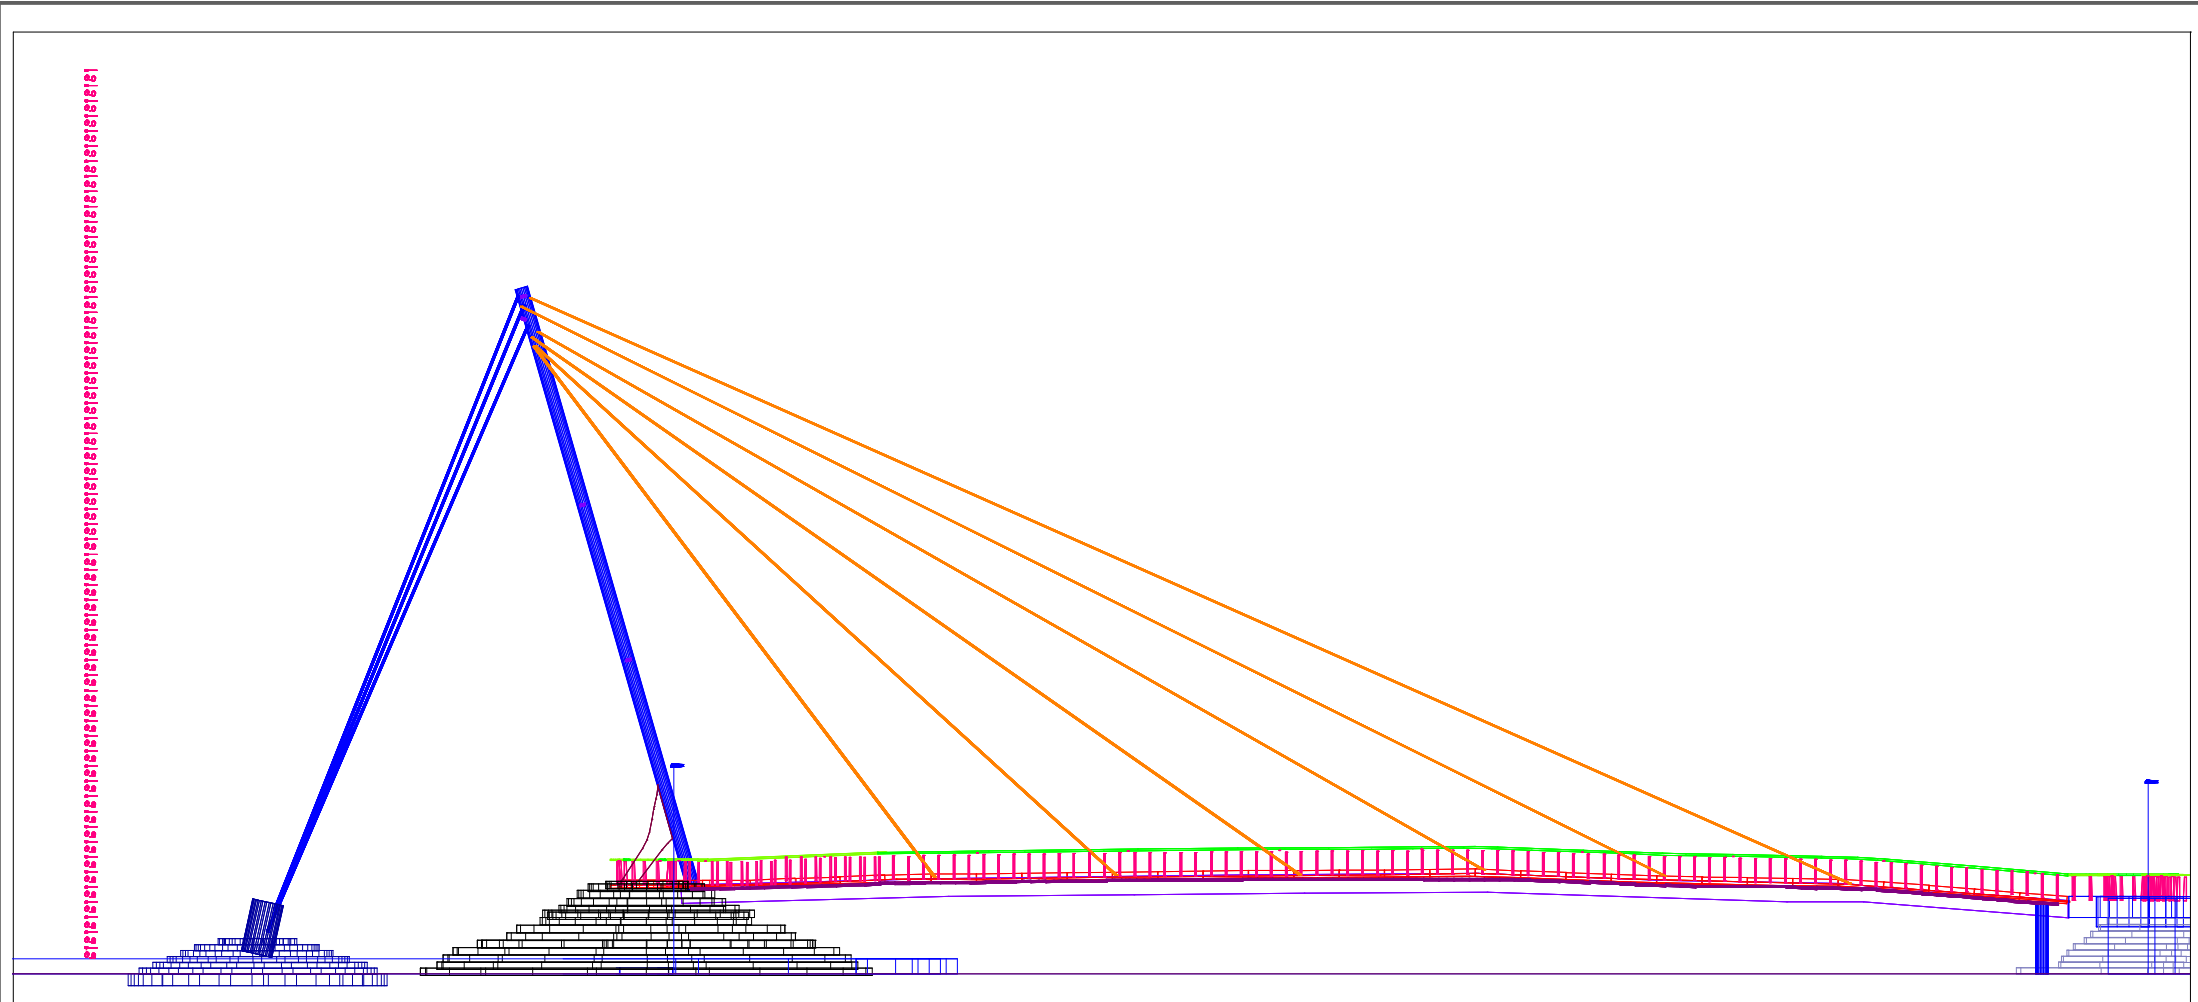

Luminaire Schedule						
Symbol	Qty	Tag	Description	Lum. Watts	Lum. Lumens	LLF
	170	L2	Eclipse G2 1M 15W LED Strip 3000K IP20 w/ Glide67 GI25	15	767	1.000
	16	L1	ewo_IDstandard 2LED_AP06-2led 80CRI-3000K-350mA	2.1	182	1.000
	6	L5	LUMENPULSE LBG-120-RGBW-VN-Lumenbeam Grande	100	3892	1.000
	3	L4	NXT LED ROADWAY LIGHTING LTD 24S-350mA-2ES-3000K	28	3234	1.000
	2	L6	LUMENPULSE LBG-120-40K-XN-Lumenbeam Grande	100	6256	1.000

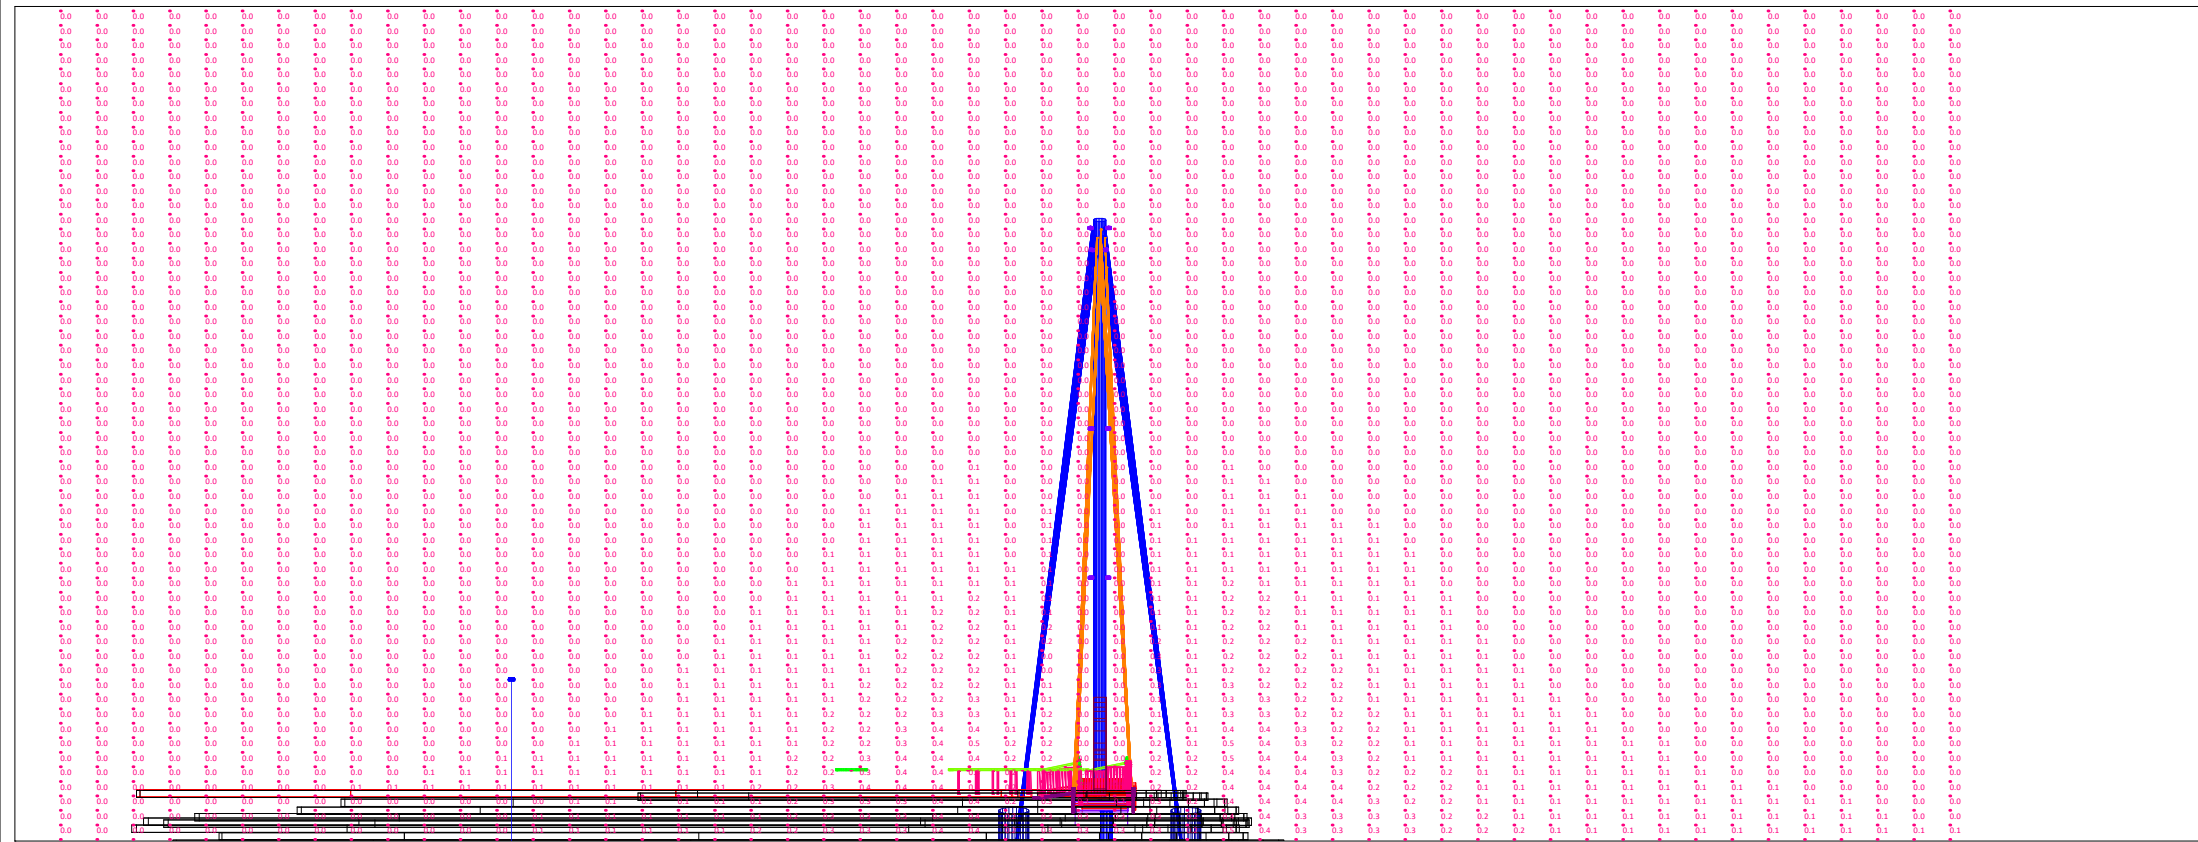

RESULTS :

Calculation Summary			
Project: Project_1			
Label	Units	Max	Min
ObtrusiveLight_1_Cd_Seg1	N.A.	1717	0
ObtrusiveLight_1_Ill_Seg1	Lux	0.6	0.0

UWLR Area Summary		
Project: Project_1		
Label	Area	UWLR
LPDArea_1	31829	0.017

DESIGN COMPLIANCE & PARAMETERS :

Designed by guidelines in the following standards:
- AS/NZS 4282:2019

Compliance to standards is the responsibility of the client.

PROJECT :

Longford Bridge
Obtrusive Light

PROJECT REFERENCE :

DESIGNER :

DATE :

27/10/2020

REV.

Pg No. 1